


SECTION C-C

NOT TO SCALE

NOTE:

1. PLACE EXPANSION JOINTS AT 3600 CENTRES WITH TOOL JOINTS AT 1200 CENTRES.
2. EXPANSION JOINT TO BE 10mm THICK BITUMEN IMPREGNATED FIBRE.
3. LONGITUDINAL EDGE TO BE ROUNDED TO 6 Ø.
4. LEDGES OR STEPS IN ANY FOOTPATH SHALL NOT EXCEED 3mm.
5. PAVING BRICKS WITH BEVELLED EDGES OR CHAMFERED ARRISSES AND HEAVILY TEXTURED & FIGURED SURFACES, SUCH AS RACKED JOINT PAVERS ARE NOT PERMITTED.

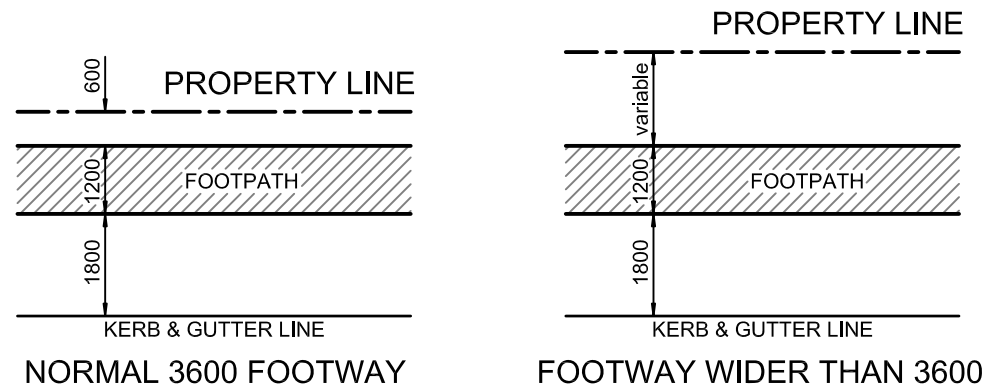

FOOTPATH LOCATION

NOT TO SCALE

NOTE:

1. FOOTPATHS ARE TO BE LOCATED WITHIN THE FOOTWAY AS SHOWN OR TO THE REQUIREMENTS OF COUNCIL'S ENGINEER.
2. WHERE FOOTWAYS ARE LESS THAN 3600 THE FOOTPATH IS TO BE A MINIMUM DISTANCE OF 600 FROM THE PROPERTY LINE.
3. FOOTPATHS SHALL BE BATTERED TO DRIVEWAYS TO PROVIDE SAFE PEDESTRIAN ACCESS.
4. REINFORCEMENT SHALL BE USED CROSSING DRIVEWAYS.
5. FOR DRIVEWAYS REFER TO S105B.

Council's Standard Drawings are currently being reviewed and revised and are provided as a guide only. The Standard Drawings are to be read in conjunction with Council's Infrastructure Specifications and if there is potential conflict between Drawings and Specifications, the requirements in the Specifications take precedence.

ALL DIMENSIONS ARE IN MILLIMETRES